


温度・湿度グラフ

2024/07/08 15:10'33

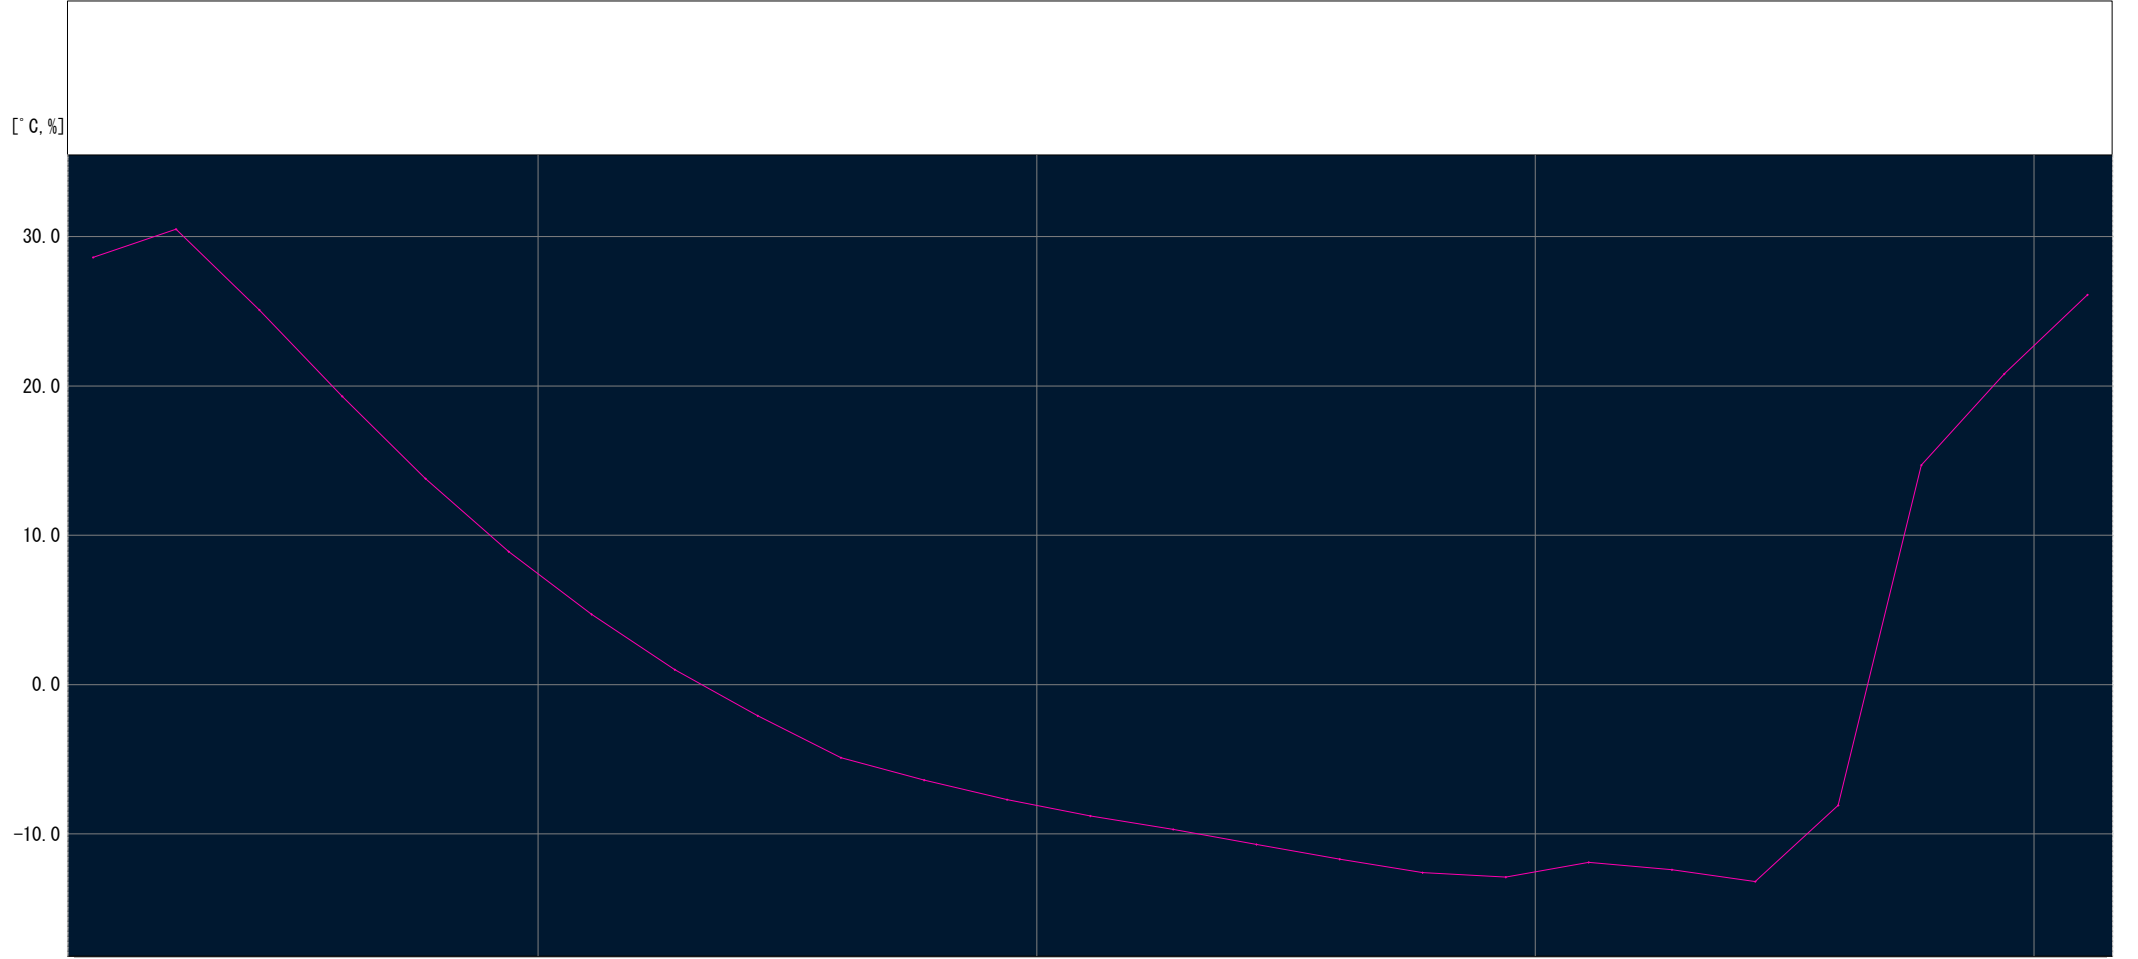

A 24/07/08 12:00'00 24/07/08 13:00'00 24/07/08 14:00'00 24/07/08 15:00'00 B

ch	Name	Intvl.	Sample	Cur. A	Cur. B	A<->B	Max.	Min.	Avg.	Unit
1	OFFICE 1	10min.	25	-----	-----	-----	30.5	-13.2	2.4	°C
Cur. A Date : 2024/07/08 11:03'23							Data Range 2024/07/08 11:03'23-2024/07/08 15:09'30			
Cur. B Date : 2024/07/08 15:09'30							Calc. Range 2024/07/08 11:06'16-2024/07/08 15:06'37			
diff. A-B : Oday 04:06'07										