


温度・湿度グラフ

2025/03/05 12:19'38

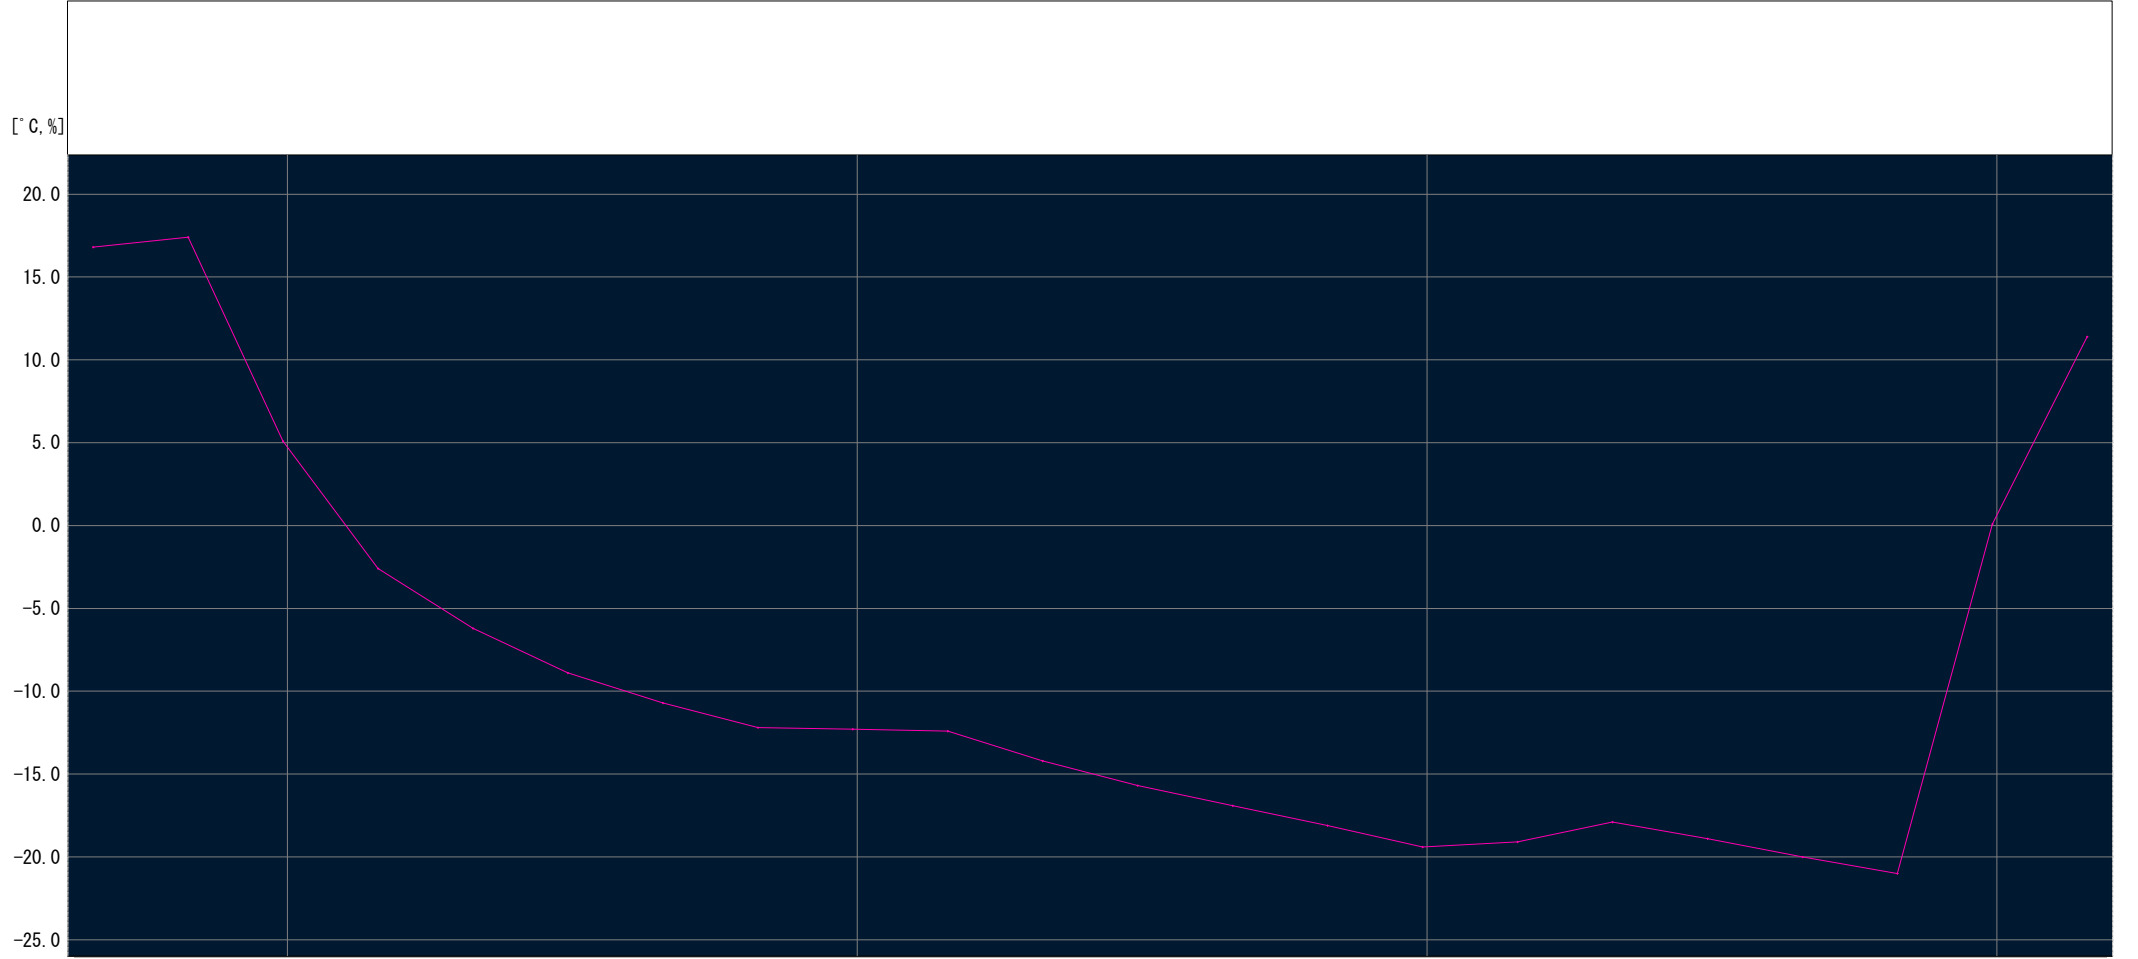

A 25/03/05 9:00'00 25/03/05 10:00'00 25/03/05 11:00'00 25/03/05 12:00'00 B

ch	Name	Intvl.	Sample	Cur. A	Cur. B	A<->B	Max.	Min.	Avg.	Unit
1	OFFICE 1	10min.	22	-----	-----	-----	17.4	-21.0	-8.9	°C
Cur. A Date : 2025/03/05 8:36'51							Data Range 2025/03/05 8:36'51-2025/03/05 12:12'14			
Cur. B Date : 2025/03/05 12:12'14							Calc. Range 2025/03/05 8:39'22-2025/03/05 12:09'43			
diff. A-B : Oday 03:35'23										